


NOTES:

- FOR EXISTING STRUCTURES KENNEBEC WATER DISTRICT (KWD) PERSONNEL WILL SUPPLY AND INSTALL WATER METER AND READING EQUIPMENT. FOR NEW STRUCTURES REQUIRING A WATER SERVICE, THE CUSTOMER SHALL PAY FOR THE METER AND READING EQUIPMENT. METER AND READING EQUIPMENT WILL REMAIN THE PROPERTY OF KWD.
- THE CUSTOMER WILL PROVIDE ALL MATERIALS OTHER THAN THE METER AND READING EQUIPMENT. METERS WILL BE INSTALLED INLINE UNLESS THE CUSTOMER CHOOSES TO PROVIDE AND INSTALL A METER HORN. SEE TABLE A FOR LAY LENGTHS AND STRAIGHT METER COUPLING SIZE.
- THE METER SHOULD BE INSTALLED AS CLOSE TO THE SERVICE ENTRANCE AS POSSIBLE WITH A 4 TO 6-IN CLEARANCE FROM ANY WALLS.
- PIPING ON BOTH SIDES OF METER MUST BE RIGID WITH AT LEAST TWO POINTS OF SUPPORT ON EACH SIDE.
- THE METER SHALL NOT BE PERMANENTLY ENCLOSED AND HAVE A MINIMUM OF 2-FT OF WORKING SPACE AROUND THE METER. METER MUST BE IN A WARM, DRY AND ACCESSIBLE LOCATION.
- ACCESSIBLE LOCATIONS SHALL INCLUDE CLOSETS WHICH ARE WELL LIT AND ACCESSED VIA THE MAIN FLOOR OF THE STRUCTURE. METERS SHALL NOT BE LOCATED ADJACENT TO ELECTRICAL DEVICES OR PANELS. METERS ARE TO BE LOCATED BETWEEN 1 AND 5 FEET FROM THE FINISHED FLOOR AND SHALL NOT REQUIRE THE USE OF A LADDER TO ACCESS. METERS SHALL NOT BE LOCATED UNDER MOBILE HOMES.
- BACKFLOW PREVENTION IS REQUIRED BY KWD PER CROSS-CONNECTION CONTROL POLICY. TYPE OF SERVICE AND DEGREE OF CROSS-CONNECTION HAZARD WILL DETERMINE THE DEVICE. BACKFLOW DEVICE SHALL BE DESIGNED FOR WHOLE BUILDING CONTAINMENT (NON-VENTED) AND INSTALLED DOWNSTREAM OF METER AND METER ISOLATION VALVE.
- THERMAL EXPANSION SHOULD BE ADDRESSED BY CUSTOMER OR CUSTOMER'S PLUMBER. CHECK LOCAL PLUMBING CODES FOR REQUIREMENTS.
- PRESSURE REDUCING VALVES SHALL BE INSTALLED AS NECESSARY TO MEET CUSTOMERS NEEDS. PRESSURE REDUCING VALVES SHALL BE LOCATED DOWNSTREAM OF THE BACKFLOW PREVENTION DEVICE.
- NO GROUND CLAMPS SHALL BE ATTACHED TO THE METER OR METER COUPLINGS.

METER SIZE REQUIREMENTS		
METER SIZE (INCHES)	STRAIGHT METER COUPLING NPSM THREAD SIZE (INCHES)	METER LAY LENGTH (INCHES)
5/8 x 3/4	1	7 3/4
3/4	1	9 1/4
1	1 1/4	11

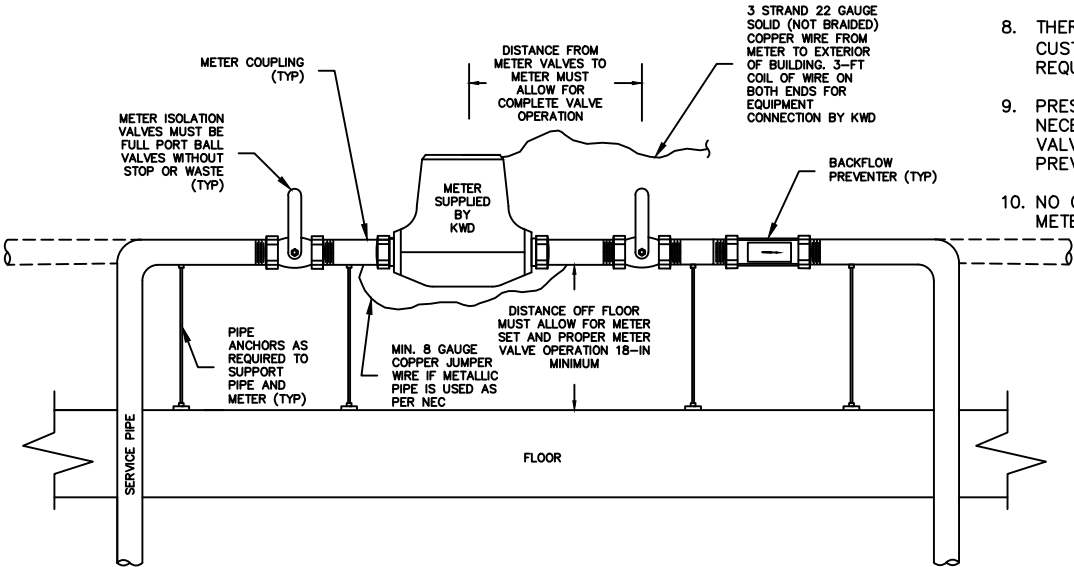

<p style="writing-mode: vertical-rl; transform: rotate(180deg);">TYPICAL RESIDENTIAL SKIRTED STRUCTURE METER INSTALLATION 5/8" TO 1"</p>	REVISION	
	DATE	
	SCALE: NTS	
	DATE: MAY 2022	